


LAr Calorimeter

Dose rates after 10 years of running and 5 days of cooling.

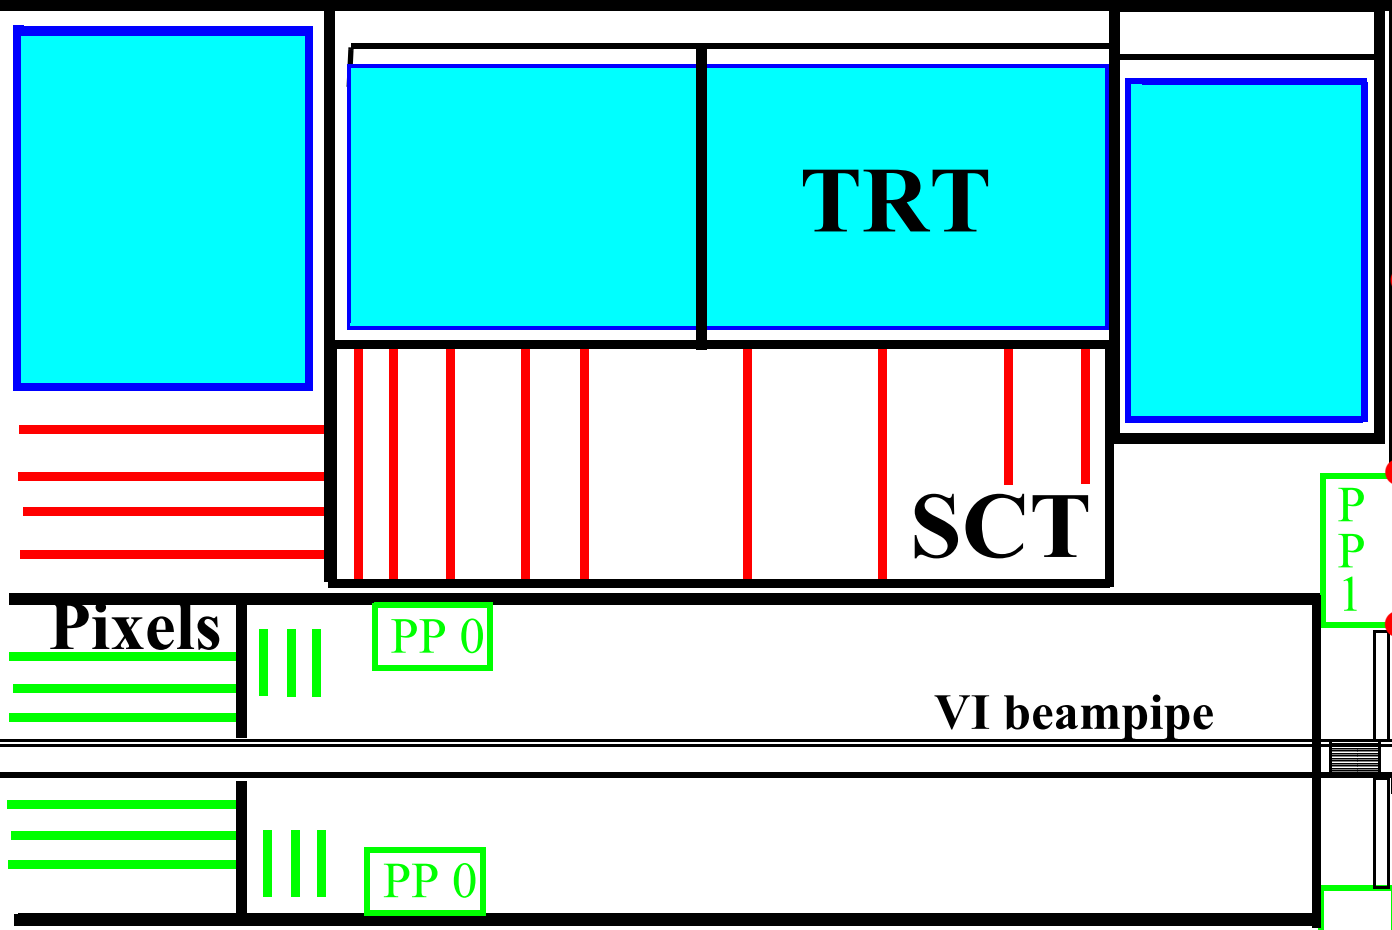

72 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
72 $\mu\text{Sv/h}$:	40	11	6	13	1
Neut. act.:	29%	35%	32%	16%	0%
Services:	88%	87%	61%		

85 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
85 $\mu\text{Sv/h}$:	52	10	5	14	3
Neut. act.:	19%	35%	32%	16%	0%
Services:	72%	85%	59%		

173 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
173 $\mu\text{Sv/h}$:	136	11	5	14	6
Neut. act.:	3%	34%	32%	16%	0%
Services:	9%	83%	59%		