


LAr Calorimeter

Dose rates after 10 years of running and 5 days of cooling.

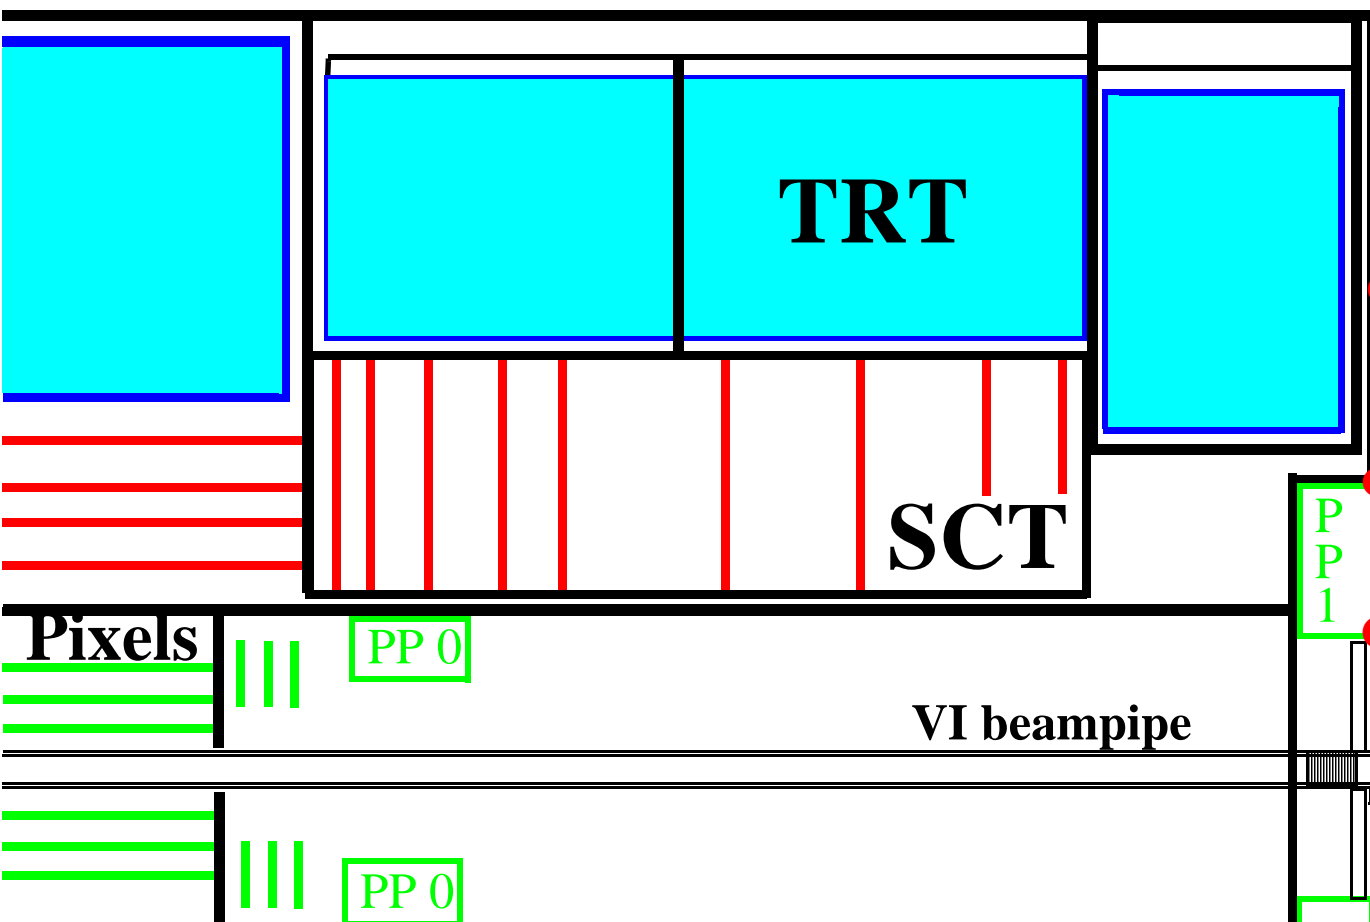

78 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
Dose rate	46	11	6	13	1
Neut. act.:	25%	35%	32%	16%	0%
Services:	77%	87%	61%		

99 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
Dose rate	66	10	5	14	3
Neut. act.:	15%	35%	32%	16%	0%
Services:	58%	85%	59%		

183 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
Dose rate	146	11	5	14	6
Neut. act.:	3%	34%	32%	16%	0%
Services:	9%	83%	59%		