


LAr Calorimeter

Dose rates after 10 years of running and 30 days of cooling.

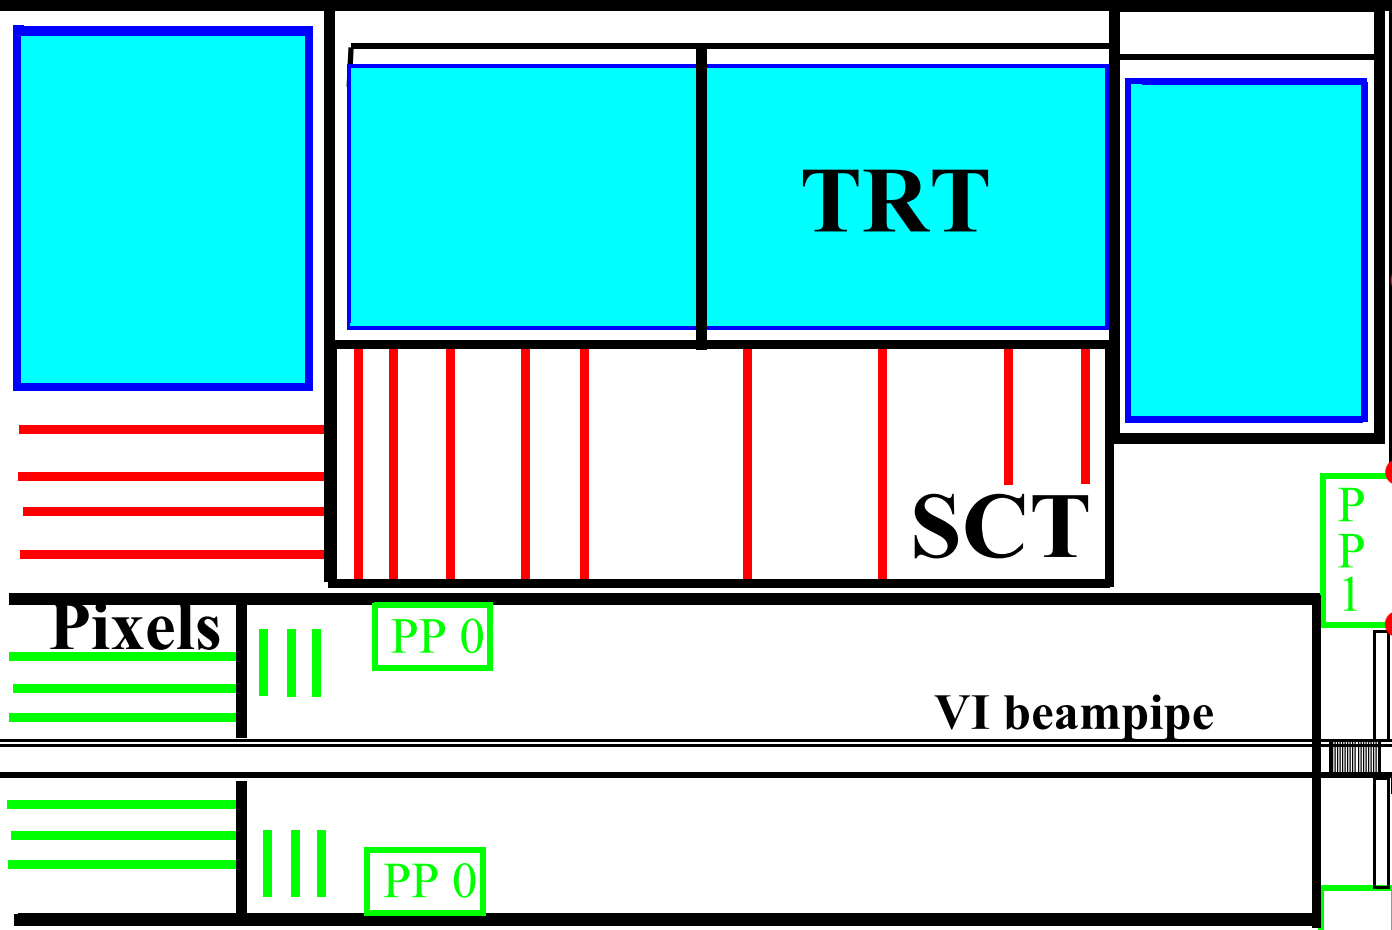

54 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
54 $\mu\text{Sv/h}$:	33	8	4	8	1
Neut. act.:	34%	42%	29%	23%	0%
Services:	88%	86%	64%		

63 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
63 $\mu\text{Sv/h}$:	41	8	3	8	3
Neut. act.:	23%	41%	30%	25%	0%
Services:	73%	84%	63%		

140 $\mu\text{Sv/h}$:

	Pixels	SCT	TRT	LAr	VI
140 $\mu\text{Sv/h}$:	114	9	3	8	6
Neut. act.:	4%	41%	30%	25%	0%
Services:	9%	82%	62%		