
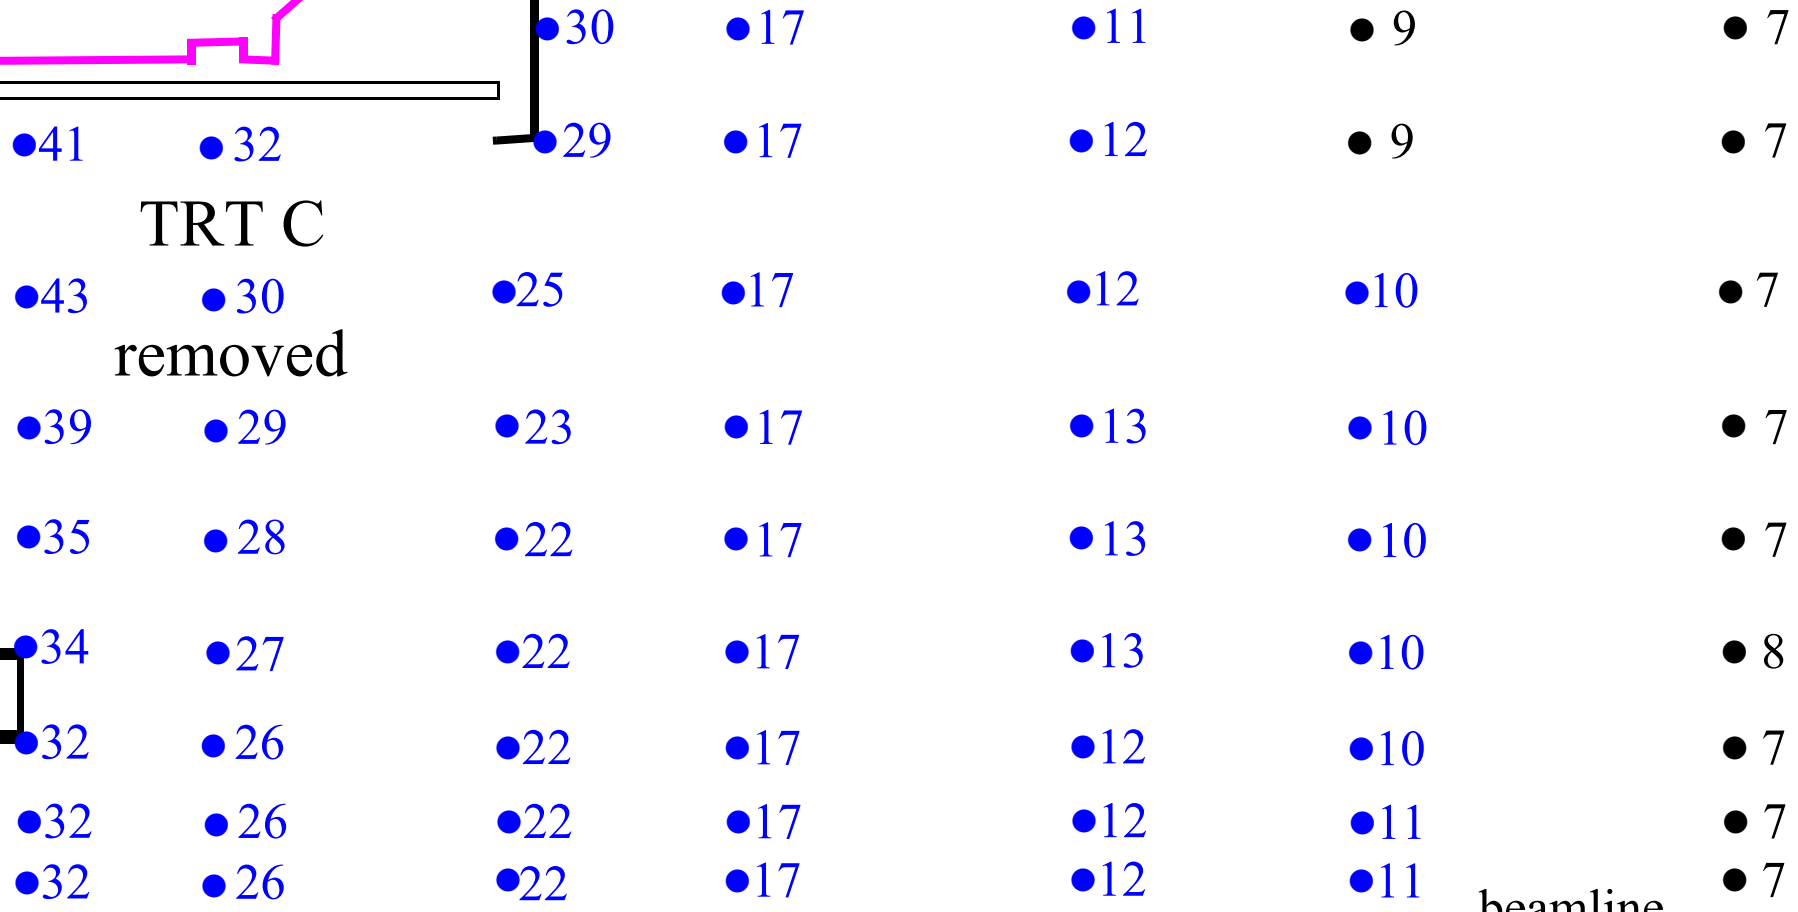


Dose rates in $\mu\text{Sv/h}$ from the inner detector and the LAr calorimeter after 2 years of running and 5 days of cooling.

LAr Calorimeter

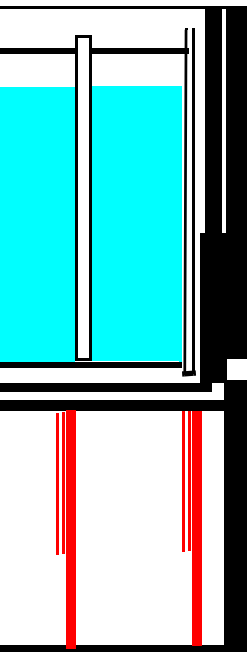

TRT C
removed

Pixels
removed

beamline

1 m

1 m